

**EQUIVALENT SOUND ABSORPTION AREA
OF SUSPENDED CEILING PANELS**

Test 21
Date 29/09/14
Station ALPHA
AA45

REQUESTER, MANUFACTURER SAINT GOBAIN ECOPHON
NAME Master Matrix 40 mm
FITNESS FOR PURPOSE Unchecked
STANDARDS EN ISO 354, EN ISO 11654, prEN 16487
CONFIGURATION A cluster of 4 panels on 400 overall depth of construction


MAIN CHARACTERISTICS

MEASUREMENT CONDITIONS

Dimensions in mm : 1000 x 4760
Area in m² : 4.8
Thickness in mm : 40
Mass per unit area in kg/m²: 3.7
Mounting type : J

Empty room: Room with sample:
Temperature: 21.5°C Temperature: 20.0°C
Relative humidity: 66% Relative humidity: 69%

RESULTS

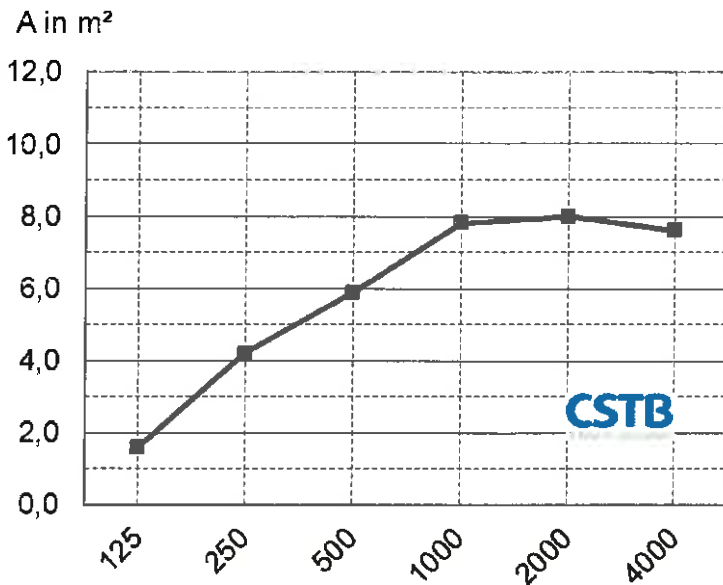

f	A
125	1,6
250	4,2
500	5,9
1000	7,8
2000	8,0
4000	7,6
Hz	m ²