Appendix 4

Sound absorption coefficient according to SS-EN ISO 11654

Measurement of sound absorption coefficient in a reverberation room

Client: Saint-Gobain Ecophon AB
Description: ODS 200 mm
Date of test: 2024-06-13

Object: Fade ONE Smooth 25 mm

Empty reverberation room:		Reverberation room with object	
Relative humidity:	79,3 %	Relative humidity:	80,5 %
Temperature:	21,8 °C	Temperature:	22,1 °C
Barometric pressure:	98,9 kPa	Barometric pressure:	99,0 kPa

Surface area: 10,80 m²
Room volume: 200,0 m³
Total room area S_t: 211,4 m²

Frequency f [Hz]	α_p 1/1 octave
100 125 160	0,35
200 250 315	0,70
400 500 630	0,75
800 1000 1250	0,85
1600 2000 2500	0,90
3150 4000 5000	0,95

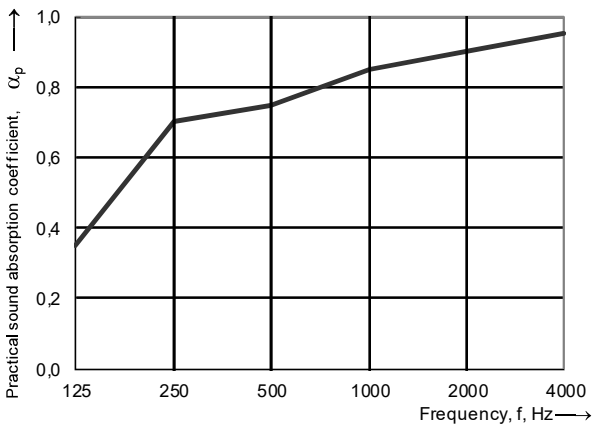

Weighted sound absorption coefficient according to ISO 11654

α_w = 0,85 Classification: B

Transaction 09222115557521744809 Signed PG, GA