

**PRACTICAL SOUND ABSORPTION COEFFICIENT α_p
OF SUSPENDED CEILING PANELS**

Test 16
Date 15/05/14
Station ALPHA
AA45

REQUESTER, MANUFACTURER SAINT GOBAIN ECOPHON
NAME Focus E 20 mm
FITNESS FOR PURPOSE Unchecked
STANDARDS EN ISO 354, EN ISO 11654, prEN 16487
CONFIGURATION 60 mm overall depth of construction


MAIN CHARACTERISTICS

Dimensions in mm : 2915 x 3500
Area in m² : 10.2
Thickness in mm : 20
Mass per unit area in kg/m²: 1.8
Mounting type : E-60

MEASUREMENT CONDITIONS

Empty room: Temperature: 18.5°C
Relative humidity: 52%
Room with sample: Temperature: 19.0°C
Relative humidity: 52%

RESULTS

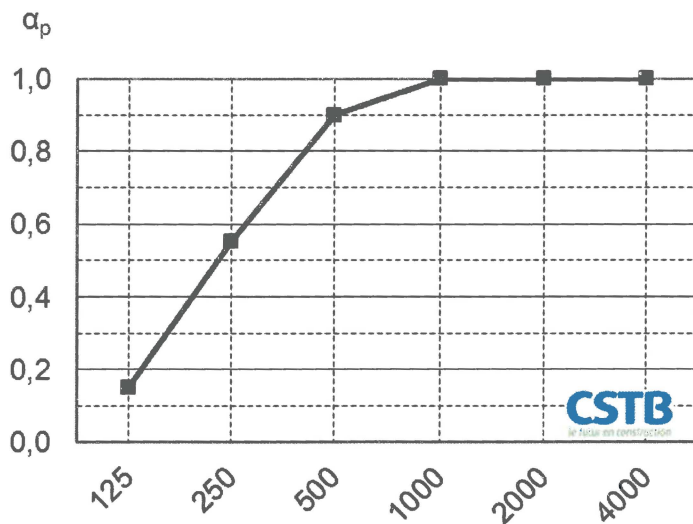

f	α_p
125	0,15
250	0,55
500	0,90
1000	1,00
2000	1,00
4000	1,00
Hz	

$\alpha_w = 0,85(H)^*$
classement / class: B

**It is strongly recommended to use this single number rating in combination with the complete sound absorption coefficient curve.*